

GLEED™ INSTALLATION INSTRUCTIONS



IMPORTANT

READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.

Fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.


WARNING: Make certain power is OFF before installing or maintaining fixture. No user serviceable parts inside.

CAUTION: Use weatherproof silicone sealant between the ceiling plate and mounting surface.

CEILING MOUNTING

Mount the fixture to a Junction Box as follows:

1. Mount the **Square Ceiling Plate** to a square junction box. Use weatherproof silicone sealant between the **Square Ceiling Plate** and mounting surface.
2. Attach **Tether Cable** to the **Housing** with **Screw** provided in the location shown.
3. Hang **Housing** on **Ceiling Plate Hooks** and make the wiring connections with UL approved connectors.
4. Swing **Housing** closed and slide as indicated by **Directional Arrows** in figure to lock the **Housing** onto the **Ceiling Plate**.
5. To unlock the fixture, slide the fixture in direction opposite to Company Logo and unhook it from **Square Ceiling Plate**.

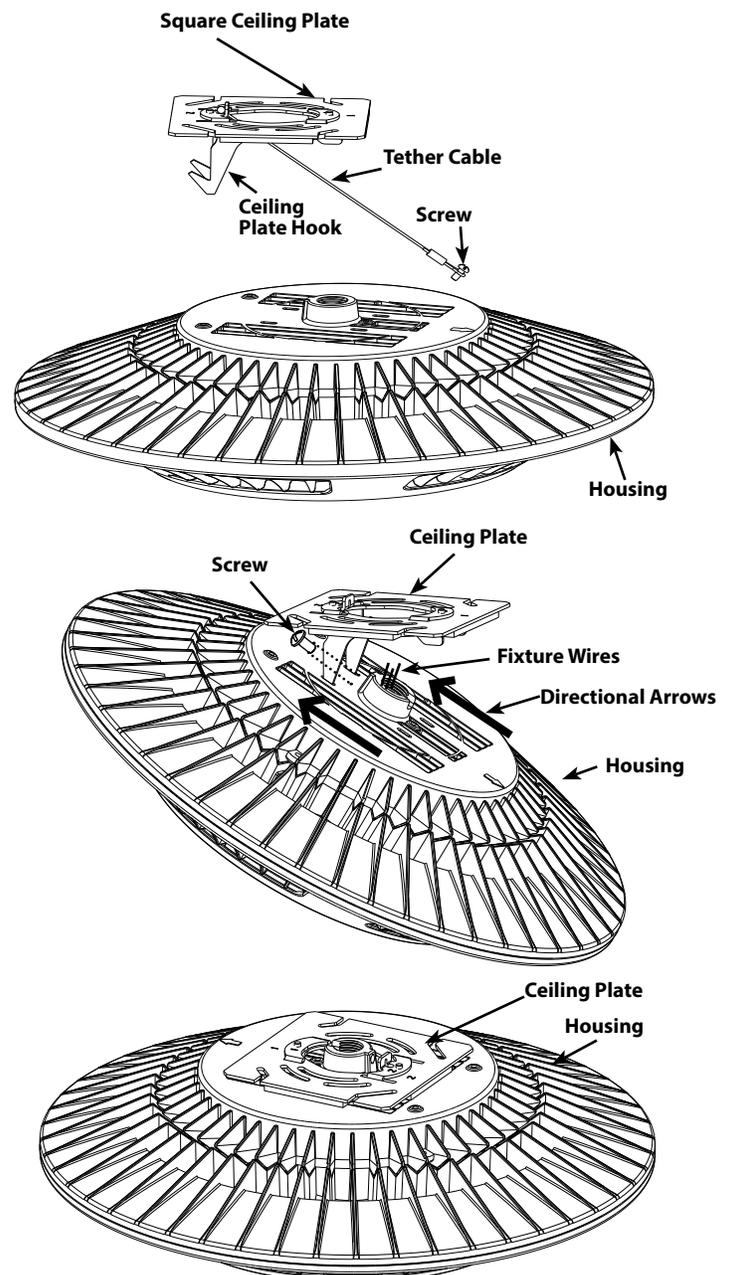

WIRING

Universal voltage driver permits operation at 120 to 277VAC, 50 or 60Hz. For Non-Dimming, follow the wiring directions as in fig. 1.

1. Connect the black fixture lead to the (+) LINE supply lead.
2. Connect the white fixture lead to the (-) COMMON supply lead.
3. Connect the bare copper Ground wire from fixture to supply ground.

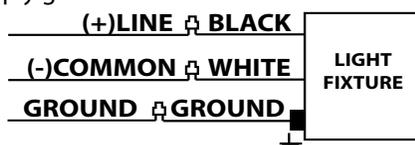


Fig. 1

GLED™ INSTALLATION INSTRUCTIONS

0-10V DIMMABLE WIRING

Universal voltage driver permits operation at 120V thru 277V, 50 or 60 Hz. For 0-10V Dimming, follow the wiring directions as in fig. 2.

1. Connect the black fixture lead to the (+) LINE supply lead.
2. Connect the white fixture lead to the (-) COMMON supply lead.
3. Connect the GROUND wire from fixture to supply ground. Do NOT connect the GROUND of the dimming fixture to the output.
4. Connect the purple fixture lead to the (V+) DIM lead.
5. Connect the gray fixture lead to the (V-) DIM lead.
6. Cap the yellow fixture lead, if present. Do NOT connect.

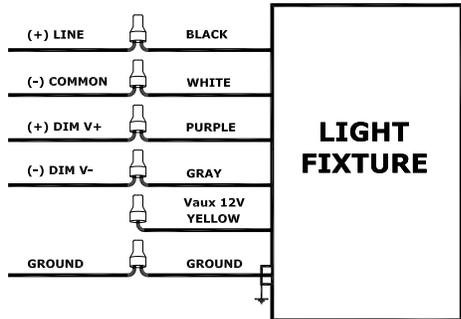


Fig. 2

CLEANING & MAINTENANCE

CAUTION: Be sure fixture temperature is cool enough to touch. Do not clean or maintain while fixture is energized.

1. Clean lens with non-abrasive glass cleaning solution.
2. Do not open fixture to clean the LED. Do not touch the LED.


TROUBLESHOOTING

1. Check that the line voltage at fixture is correct. Refer to wiring directions.
2. Is the fixture grounded properly?

OPTIONS

- Suffix "Y" = Warm 3000K LED
- Suffix "N" = Neutral 4000K LED

Note: These instructions do not cover all details or variations in equipment nor do they provide for every possible situation during installation operation or maintenance.

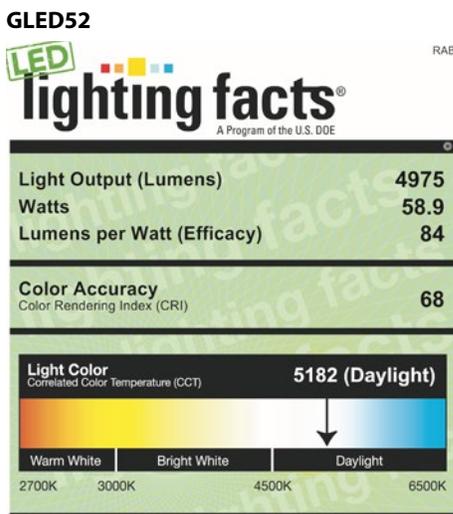

All results are according to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting. The U.S. Department of Energy (DOE) verifies product test data and results.

Visit www.lightingfacts.com for the Label Reference Guide.

Registration Number: WVMA-SXXXMJ (12/11/2013)
Model Number: GLED52 [Upgrade : 12/31/2013]
Type: Luminaire - Parking Garage




All results are according to IESNA LM-79-2008: Approved Method for the Electrical and Photometric Testing of Solid-State Lighting. The U.S. Department of Energy (DOE) verifies product test data and results.

Visit www.lightingfacts.com for the Label Reference Guide.

Registration Number: WVMA-21U2SA (12/11/2013)
Model Number: GLED78 [Upgrade : 12/31/2013]
Type: Luminaire - Parking Garage

GPLED™ & PLED™ INSTALLATION INSTRUCTIONS

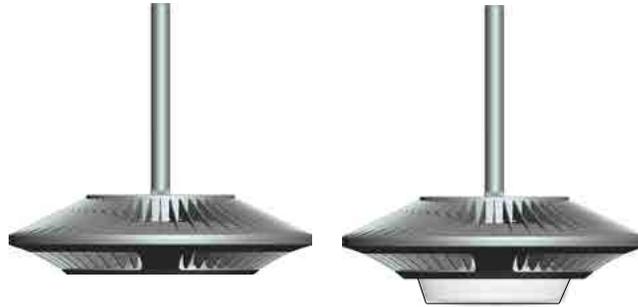

IMPORTANT

READ CAREFULLY BEFORE INSTALLING FIXTURE. RETAIN THESE INSTRUCTIONS FOR FUTURE REFERENCE.


Fixtures must be wired in accordance with the National Electrical Code and all applicable local codes. Proper grounding is required for safety. THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

WARNING: Make certain power is OFF before installing or maintaining fixture. No user serviceable parts inside.

PENDANT MOUNTING

Choose pendant length and mount the PLED to a junction box as follows:

1. Use Pendant Rod with 1/2" NPS thread (not supplied). Fixture is supplied with (50") leads.
2. Feed **Housing wires** through **Pendant** and thread the **Pendant** onto the **Housing**. Wrap teflon tape or silicone gel onto the threads to prevent moisture from getting into the **Housing**.
3. Tighten the set screw on the side of the **Housing**.
4. Make the wiring connections with UL approved connectors at the junction box.

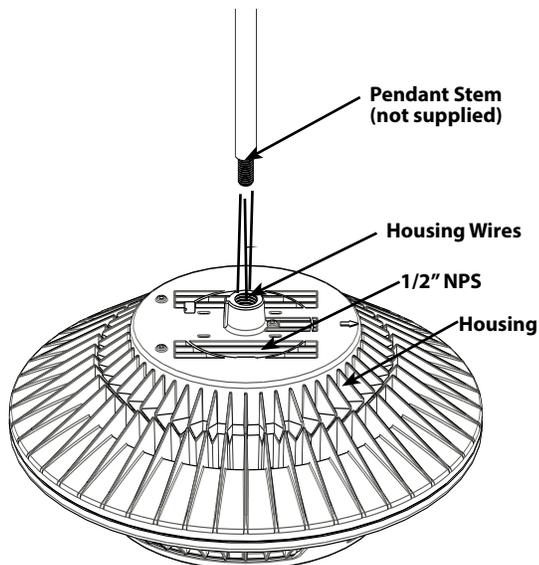

0-10V DIMMABLE WIRING

Universal voltage driver permits operation at 120V thru 277V, 50 or 60 Hz. 0-10V control wires must be rated for 300V minimum. For 0-10V Dimming, follow the wiring directions as in fig. 2.

1. Connect the black fixture lead to the (+) LINE supply lead.
2. Connect the white fixture lead to the (-) COMMON supply lead.
3. Connect the GROUND wire from fixture to supply ground. Do NOT connect the GROUND of the dimming fixture to the output.
4. Connect the purple fixture lead to the (V+) DIM lead.
5. Connect the gray fixture lead to the (V-) DIM lead.
6. Cap the yellow fixture lead. Do NOT connect.

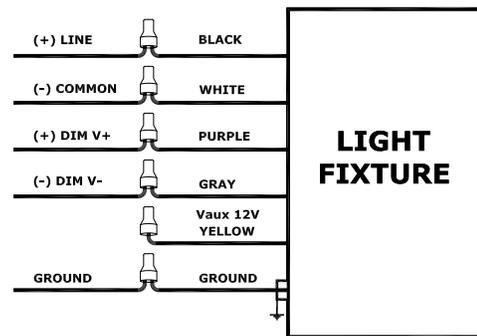


Fig. 2

Note: These instructions do not cover all details or variations in equipment nor do they provide for every possible situation during installation operation or maintenance.

GPLED™ & PLED™ INSTALLATION INSTRUCTIONS

WIRING

Universal voltage driver permits operation at 120 to 277VAC, 50 or 60Hz., except fixtures factory ordered with 480V. Units ordered with (/480) suffix are 480V.

1. Connect the black fixture lead to the (+)LINE supply lead.
2. Connect the white fixture lead to the (-) COMMON supply lead.
3. Connect the bare copper Ground wire from fixture to supply ground.



CLEANING & MAINTENANCE

CAUTION: Be sure fixture temperature is cool enough to touch. Do not clean or maintain while fixture is energized.

1. Clean lens with non-abrasive glass cleaning solution.
2. Do not open fixture to clean the LED. Do not touch the LED.

TROUBLESHOOTING

1. Check that the line voltage at fixture is correct. Refer to wiring directions.
2. Is the fixture grounded properly?